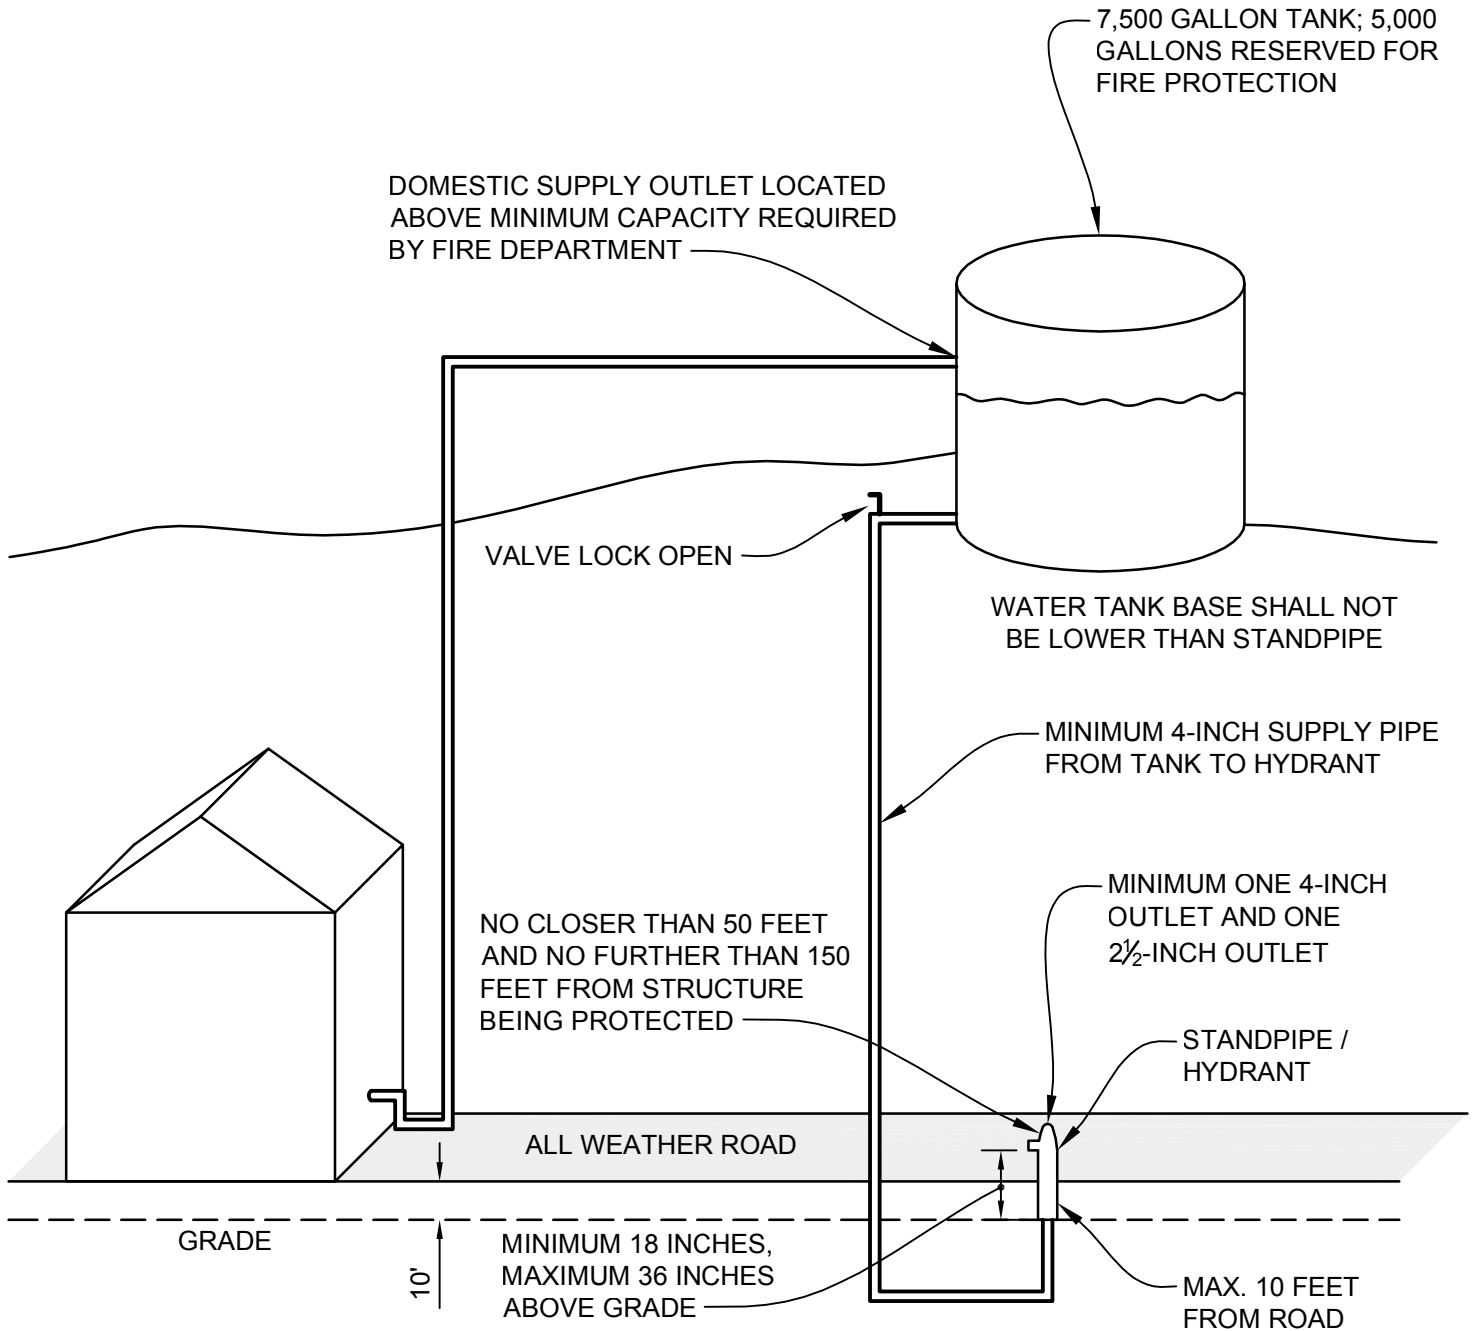


**EXAMPLE:**

ELEVATED WATER TANK WITH AUTOMATIC REFILL DEVICE, 5,000 GALLONS MINIMUM CAPACITY. DOMESTIC STORAGE OUTLET SHALL BE LOCATED ABOVE THE 5,000 GALLON MINIMUM CAPACITY.



**FIGURE: 4b-1**

**SINGLE TANK SUPPLYING FIRE PROTECTION AND DOMESTIC USE**

**MONTECITO FIRE DEPARTMENT**